


**JUMPERS TO SET
OUTPUT SIGNAL**

**TWO OUTPUT SIGNALS:
DRY CONTACT OR
12VDC LIVE SIGNAL**

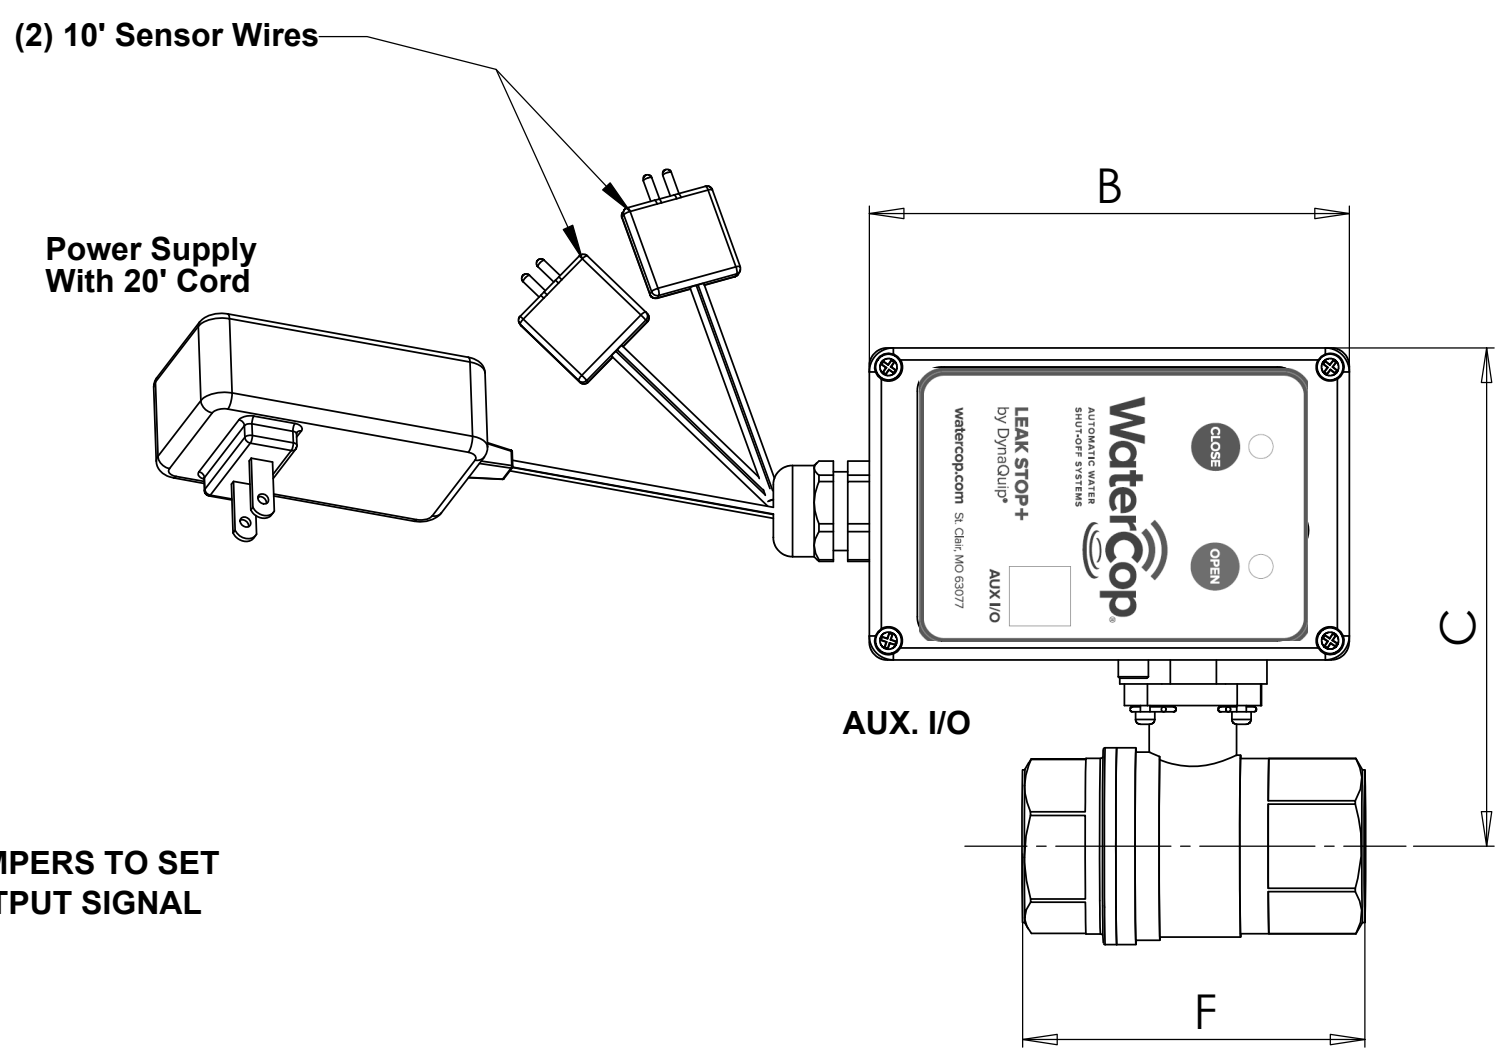

**ALL VALVES ARE CERTIFIED
TO NSF/ANSI 372 FOR USE
WITH POTABLE WATER**

Model	Valve Size	A	B	C	D	E	F	Ends
WCLSLFB 1/2	1/2	5.00	3.75	4.72	.74	3.25	2.60	1/2 - 14 NPT
WCLSLFB 3/4	3/4	5.00	3.75	5.02	.74	3.25	2.90	3/4 - 14 NPT
WCLSLFB 1	1	5.00	3.75	5.17	.74	3.25	3.56	1 - 11-1/2 NPT
WCLSLFB 1-1/4	1 1/4	5.00	3.75	5.44	.74	3.25	3.66	1-1/4 - 11-1/2 NPT

**UNCONTROLLED
DRAWING**

THIS PRINT IS THE PROPERTY OF DYNAQUIP CONTROLS AND SHALL NOT BE COPIED, REPRODUCED, LOANED, OR DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN THAT FOR WHICH IT IS SPECIFICALLY FURNISHED EXCEPT BY WRITTEN PERMISSION OF DYNAQUIP CONTROLS.

NO. LEAKSTOP+ FILE NO. SUB. 465

AUTOMATIC WATER SHUT OFF SYSTEM

DR	DATE	CHKD	DATE	ENGR	DATE
MJP	07-08-19	MJP	07-08-19	MJP	07-08-19